Пропорциональные клапаны DRE, DREM
Технические характеристики

По вопросам продаж и поддержки обращайтесь:

Алматы (7273)495-231
Архангельск (8182)63-90-72
Астрахань (8512)99-46-04
Барнаул (3852)73-04-60
Белгород (4722)40-23-64
Брянск (4832)59-03-52
Владивосток (423)249-28-31
Волгоград (844)278-03-48
Вологда (8172)26-41-59
Воронеж (473)204-51-73
Екатеринбург (343)384-55-89
Иваново (4932)77-34-06
Ижевск (3412)26-03-58
Иркутск (395)279-98-46
Казань (843)206-01-48
Калининград (4012)72-03-81
Калуга (4842)92-23-67
Кемерово (3842)65-04-62
Киров (8332)68-02-04
Краснодар (861)203-40-90
Красноярск (391)204-63-61
Курск (4712)77-13-04
Липецк (4742)52-20-81
Магнитогорск (3519)55-03-13
Москва (495)268-04-70
Мурманск (8152)59-64-93
Набережные Челны (8552)20-53-41
Нижний Новгород (831)429-08-12
Новокузнецк (3843)20-46-81
Новосибирск (383)227-86-73
Омск (3812)21-46-40
Орел (4862)44-53-42
Оренбург (3532)37-68-04
Пенза (8412)22-31-16
Пермь (342)205-81-47
Ростов-на-Дону (863)308-18-15
Рязань (4912)46-61-64
Самара (846)206-03-16
Санкт-Петербург (812)309-46-40
Саратов (845)249-38-78
Севастополь (8692)22-31-93
Симферополь (3652)67-13-56
Смоленск (4812)29-41-54
Сочи (862)225-72-31
Ставрополь (8652)20-65-13
Сургут (3462)77-98-35
Тверь (4822)63-31-35
Томск (3822)98-41-53
Тула (4872)74-02-29
Тюмень (3452)66-21-18
Ульяновск (8422)24-23-59
Уфа (347)229-48-12
Хабаровск (4212)92-98-04
Челябинск (351)202-03-61
Череповец (8202)49-02-64
Ярославль (4852)69-52-93

Россия (495)268-04-70
Киргизия (996)312-96-26-47
Казахстан (7172)727-132

rhg@nt-rt.ru || https://rekith.nt-rt.ru/

DRE(E)/DREM(E)...type Proportional Pilot Operated Reducing Valve

DRE(E)/ DREM(E)...6X...type

Sizes 10, 25
Max. Working Pressure: 315 bar
Max. Flow: 300 L/min

Contents

Features

- For sub-plate mounting:
- Porting pattern to DIN 24 340 form D and ISO 5781
- For installation in manifolds
- 4 pressure ratings
- Maximum pressure limitation, optional
- Digital amplifier type VT-2000 of modular design

Function and configuration

DRE/DREM type valve is a pilot operated pressure reducing valve. It is used for pressure reduction. The valve consists of pilot valve(1) with proportional solenoid (2), main valve (3) with main spool assembly (4), as well as an optional check valve (5).

Type DRE10...
The setting of the pressure in port A is dependent on the voltage present at the proportional solenoids (2). At static, proportional solenoids (2) breakaway, the connection from B to A opens and fluid can flow freely from Port B to port A via main spool (4).
When valve works, pressure fluid from port A acts on the spring load side of the main spool (4) via pilot valve with throttle (6), (7) and (8), and at the same time acts on spool (10) effected by electromagnetic force. If pressure at port A exceeds the preset value of the corresponding proportional solenoid (2) , then the spool (10) opens. Signal and pilot fluid is from port A, and fluid flows to tank through spool (10) and port Y .
There is pressure differential on main spool (4) which makes itself into controller position and keeps flow constant pressure in port A as same as the setting value of the proportional solenoids (2). If the pressure in the port A increases and the main spool (4) is closed, little fluid will flow to tank via hole (9) and port Y. In order to allow free-flow from port A to B a check valve (5) can be fitted.

Type DRE20...
Same principle with DRE10 in function and pilot oil drains out from channel (9) and port B. There is a flow control valve (11) fixed in the pilot valve (1) to relief the pilot oil. And the overload protector (12) in the port A can prevent the pressure from abnormally high when flow Q=0.

Type DREM...
A spring loaded pressure relief valve (13) can be optionally installed to prevent higher pressure in port A caused by abnormal peak voltage of proportional solenoids.

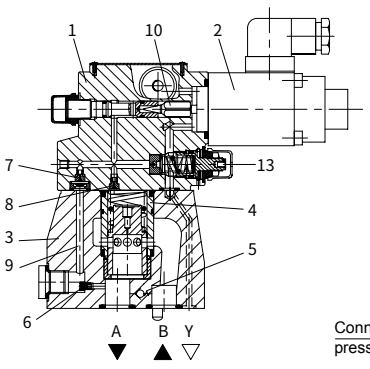

Type DREM10...

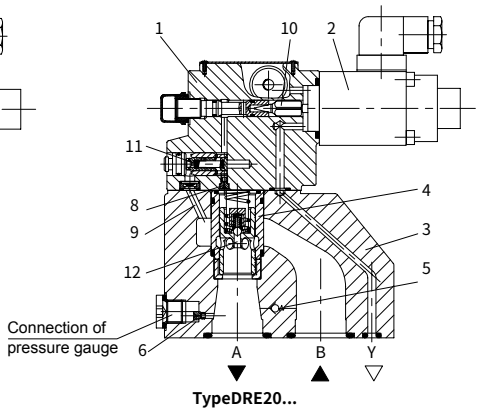

TypeDRE20...

Symbols

DRE -6XJ/...**YM**…



DREM -6XJ/...**YM**…



DRE -6XJ/...**Y**…



DREM -6XJ/...**Y**…



DREE -6XJ/...**YM**…



DREME -6XJ/...**YM**…



DREE -6XJ/...**Y**…



DREME -6XJ/...**Y**…



Ordering code

DRE | | | | 6XJ/ | | | G24 | / | / | | ★

Without maximum pressure safety =No code
With maximum pressure safety = M

Pilot operated = No code
Pilot operated valve for size 10 = CN
(do not enter nom. size)
Pilot operated valve for size 20 and 30 = CH
(do not enter nom. size)
Pilot operated valve with = CN
main spool assembly for size 10
(enter nom. size 10)
Pilot operated valve with = CH
main spool assembly for size 30
(enter nom. size 30)

For external control electronics =No code
With integrated electronics (OBE) = E

Nominal size 10 = 10
Nominal size 25 = 20

Series60J to 69J = 6XJ

Max. pressure 50 bar = 50
Max. pressure 100 bar = 100
Max. pressure 200 bar = 200
Max. pressure 315 bar = 315

Further information in plain text

V = FKM seals
No code = NBR seals

Pilot oil drain port Y
No code = Inch threaded
2 = Metric threaded

For type DBE(M)E:
A1= Command/actual value 0-10V
F1= Command/actual value 4 to 20 mA

For type DBE(M)E:
K31 = With component plug, Without plug-in connector
Z31 = With component plug and plug-in connector

For type DBE(M)E, Supply voltage
G24= + 24 V DC

No code= With check valve
M= Without check valve

Y= Pilot oil drain always external, separate and zero pressure to the tank

Technical data

Fluid			Mineral oil suitable for NBR and FKM seal		
			Phosphate ester for FKM seal		
Fluid temperature range		°C	-30 to +80 (NBR seal)		
			-20 to +80 (FKM seal)		
Viscosity range		mm^2/s	2.8 to 380		
Degree of contamination			Maximum permissible degree of fluid contamination: Class 9. NAS 1638 or 20/18/15, ISO4406		
Max. operating pressure	Port A, B	bar	315		
	Port Y		Back to tank with zero pressure		
Max. setting pressure	Port A	bar	50; 100; 200; 315		
Min. setting pressure	Port A		Dependent with Q, see characteristic curves		
Pressure at current value 0 in port A			=Min. settable pressure (see characteristic curves)		
Max. pressure limitation(stepless)			Setting pressure	setting range under max. pressure limition	
			50 bar	10-60^{+20} bar	
			100 bar	10-120^{+20} bar	
			200 bar	10-220^{+20} bar	
			315 bar	10-340^{+20} bar	
Max. pressure limition setting range			When rated pressure=50 bar, between 60~80 bar		
			When rated pressure=100 bar, between 120~140 bar		
			When rated pressure=200 bar, between 220~240 bar		
			When rated pressure=315 bar, between 340~360 bar		
Nominal size			10	25	32
Max. flow-rate		L/min	80	200	300
Pilot flow-rate (for pilot valve)		L/min	0.7 to 2		
Linearity			±3.5%		
Repeatability			<±2%		
Magnetic creeping			with shimmy		without shimmy
			±2.5% P max (200Hz, amplitude 200mAss)		±4.5% P max
Shifting time			100 to 300ms (dependent with the system)		

Electrical data

Supply voltage		DC
Min. solenoid current	mA	100
Max. solenoid current	mA	800
Coil resistance		19.5Ω at 20°C , Max. warm value :28.8Ω
Working status		Continuous
Max. working enviromental temperature		+50°C
Electrical connection		Plug-in connector to DIN EN 175301-803/ISO 4400
Valve protection to DIN 40 050		IP 65
Ampilfier		VT2000

Characteristic curves (Measured at ϑ_{oil}=40°C ±5°C , using HLP46)

Pressure in port A in relation to flow

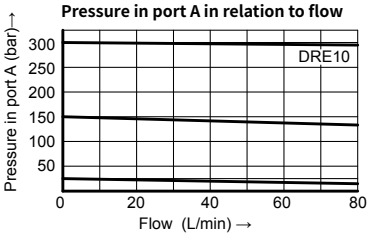

Pressure in port A in relation to flow

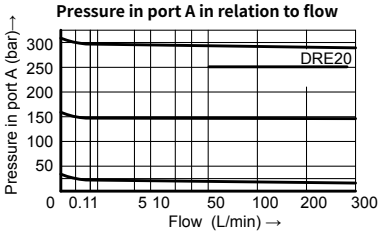

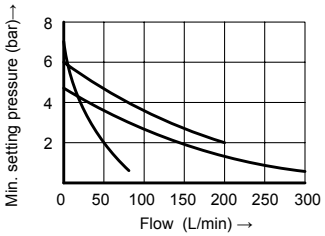

Pressure of port A and port B

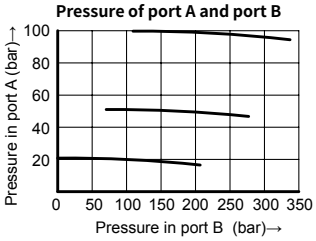

Input pressure/current of DRE10,20

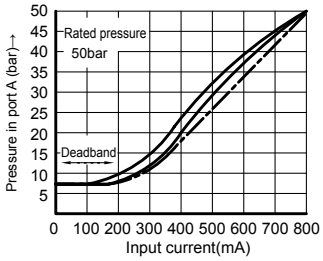

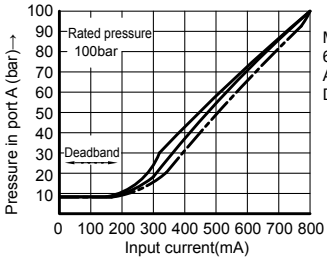

Measured flow
6L/min from
A to B of type
DRE10, 20

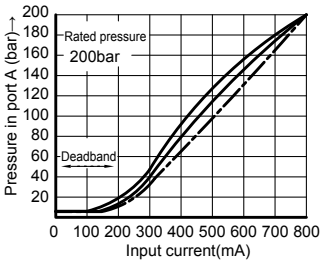

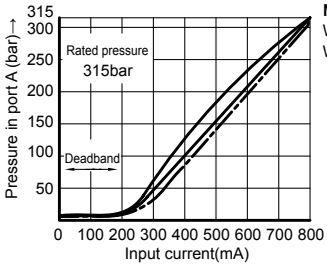

Magnetic creeping
With flutter ——
Without flutter —-—

Unit dimensions

(Dimensions in mm)

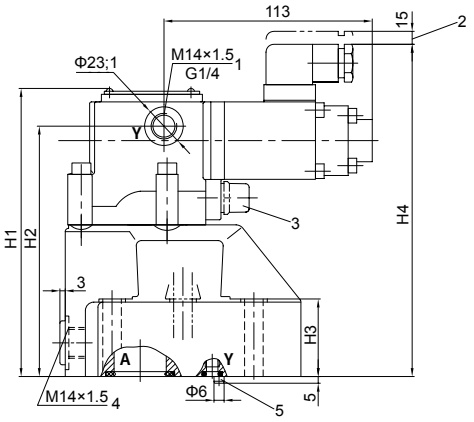

1 As supplied, this port is plugged.
After removal of this plug this port can also be used as an external pilot oil drain.
2 Space required to remove plug-in connector.
3 Max. pressure limitation
(its application see hereinbefore "note")
4 Port X used for remote controlling the DRE10 and pressure gauge connection on DRE20
5 Locating pin
6 Name plate
7 Pilot oil drain always external and separate to tank at zero pressure.
8 Dead hole
9 Valve fixing screw holes

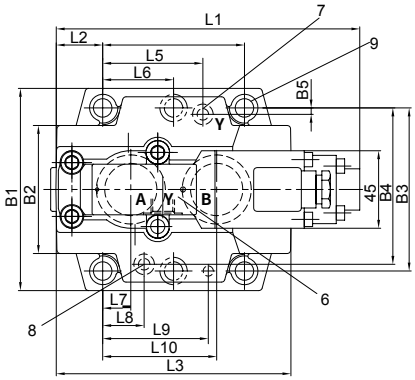

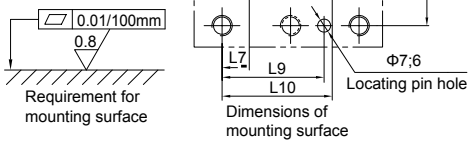

Size	B1	B2	B3	B4	B5	O-ring (port A and B)				O-ring (port X and Y)			D	H4
10	85	50	66.7	58.8	7.9	17.12×2.62				9.25×1.78			13	188
25	102	59.5	79.4	73	6.4	28.17×3.53				9.25×1.78			22	198
32	120	76	96.8	92.8	3.8	34.52×3.53				9.25×1.78			30	206
Size	L1	L2	L3	L4	L5	L6	L7	L8	L9	L10	H1	H2	H3	Weight
10	181	35.5	96	42.9	21.5	-	7.2	21.5	31.8	35.8	152	136.5	28	5.2kg
25	177	33.5	112	60.3	39.7	-	11.1	20.6	44.5	49.2	162	146.5	38	6.3kg
32	176.5	28	140	84.2	59.5	42.1	16.7	24.6	62.7	67.5	170	154.5	46	8.6kg

Unit dimensions

(Dimensions in mm)

Insert cartridge valve

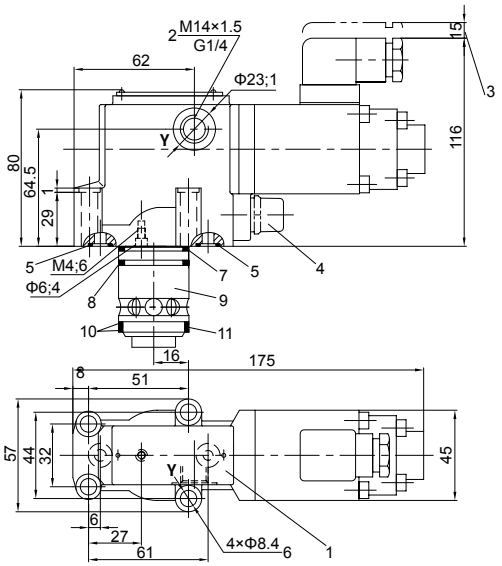

1 Name plate
2 (Port Y)pilot oil drain always external and separate to tank at zero pressure.
3 Space required to remove plug-in connector.
4 Max. pressure limitation (its application see hereinbefore "note")
5 O-ring 9.25×1.78
6 Valve fixing screw hole
7 O-ring 28×2.65
8 O-ring 28×1.8
9 Main spool assembly
10 Retaining ring 28.4×32×0.8
11 O-ring 27.3×2.4
12 Retaining ring and O-ring should be fixed onto the hole before fixing the main spool.
13 The throttle in the DREC10 must be ordered separately; and the cartridge assembly includes the main spool and throttle.
14 Cannelure's diameter D2 can meet hole diameter D3, but must pay attention don't damage the port and the valve fixing holes.
15 Pilot lines of DRE CH20
16 Pilot lines of DRE CH10.

Size	D1	D2	D3	Main spool assembly ordering code		Valve fixing screws	Tightening torque	Weight
10	10	40	10	306 727	306 728	4pcs M8×40 GB/T70.1-10.9 Internal hexagon screw	20Nm	3kg
25	20	45	20	306 729	306 730			
32	30	45	30	(NBR)	(FKM)			

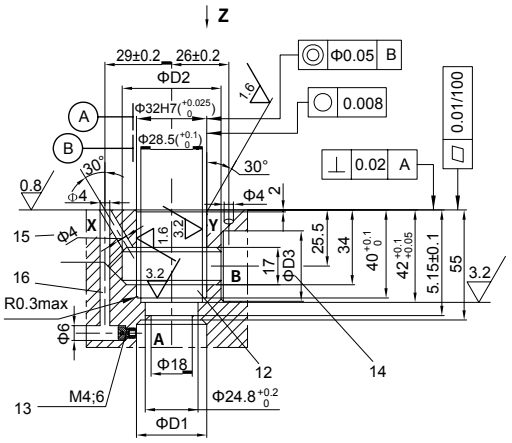





По вопросам продаж и поддержки обращайтесь:

Алматы (7273)495-231
Архангельск (8182)63-90-72
Астрахань (8512)99-46-04
Барнаул (3852)73-04-60
Белгород (4722)40-23-64
Брянск (4832)59-03-52
Владивосток (423)249-28-31
Волгоград (844)278-03-48
Вологда (8172)26-41-59
Воронеж (473)204-51-73
Екатеринбург (343)384-55-89
Иваново (4932)77-34-06
Ижевск (3412)26-03-58
Иркутск (395)279-98-46
Казань (843)206-01-48
Калининград (4012)72-03-81
Калуга (4842)92-23-67
Кемерово (3842)65-04-62
Киров (8332)68-02-04
Краснодар (861)203-40-90
Красноярск (391)204-63-61
Курск (4712)77-13-04
Липецк (4742)52-20-81
Магнитогорск (3519)55-03-13
Москва (495)268-04-70
Мурманск (8152)59-64-93
Набережные Челны (8552)20-53-41
Нижний Новгород (831)429-08-12
Новокузнецк (3843)20-46-81
Новосибирск (383)227-86-73
Омск (3812)21-46-40
Орел (4862)44-53-42
Оренбург (3532)37-68-04
Пенза (8412)22-31-16
Пермь (342)205-81-47
Ростов-на-Дону (863)308-18-15
Рязань (4912)46-61-64
Самара (846)206-03-16
Санкт-Петербург (812)309-46-40
Саратов (845)249-38-78
Севастополь (8692)22-31-93
Симферополь (3652)67-13-56
Смоленск (4812)29-41-54
Сочи (862)225-72-31
Ставрополь (8652)20-65-13
Сургут (3462)77-98-35
Тверь (4822)63-31-35
Томск (3822)98-41-53
Тула (4872)74-02-29
Тюмень (3452)66-21-18
Ульяновск (8422)24-23-59
Уфа (347)229-48-12
Хабаровск (4212)92-98-04
Челябинск (351)202-03-61
Череповец (8202)49-02-64
Ярославль (4852)69-52-93

Россия (495)268-04-70
Киргизия (996)312-96-26-47
Казахстан (7172)727-132

rhg@nt-rt.ru || https://rekith.nt-rt.ru/